

General building permit requirements Decks

The following items are required to obtain a General Building Permit for a deck:

1. Any required county permits
2. Any required town or village permits
3. A completed General Building Permit Application(all applicable information)
4. Building plans which include:
 1. Dimensions of the deck
 2. Structural member sizes (joists, post, and beams)
 3. Footing sizes and locations
 4. A completed checklist from the deck information
5. A site plan showing:
 1. Lot lines
 2. Location of proposed structure
 3. Location of all structures on the subject property
 4. Location of well and septic or sewer/water laterals as applicable
6. **Builders/Contractors** applying for a building permit must supply their **Dwelling Contractor Credential** number with expiration date and their **Dwelling Contractor Qualifier Credential** number with expiration date.
7. Homeowners applying for a building permit must sign the **Cautionary Statement to Owners** in accordance with s 101.65 (1r), Stats.

IMPORTANT NOTICE

The work you are doing under this permit must be inspected!

Inspections for the following must be made prior to proceeding to the next phase:

1. Footings (forms in place, **prior** to pouring concrete).
2. Prior to installing decking if deck is less than 3 feet above grade.
3. After deck is completed.

Any questions or to schedule an inspection, please call or text Rodney at (608) 617-9253 or Email to rschoepke@generalengineering.net

| | | | | | | | |
|--|--|--|---------------------------|--|-------------|---|------------------------|
| FOR INSPECTIONS CALL: _____ | | GENERAL BUILDING PERMIT APPLICATION GENERAL ENGINEERING COMPANY OFFICE: (608) 745-4070 FAX: (608) 745-5763 | | | | PERMIT # _____ | |
| | | | | | | EXPIRATION DATE: _____ | |
| Parcel Number: _____ | | Property is Located in <input type="checkbox"/> Town of _____ <input type="checkbox"/> Village of _____ <input type="checkbox"/> City of _____ | | | | Municipality Number _____ | |
| PROJECT DESCRIPTION (Submit Building Plans & Site Plan) | | | | | | Does this project require any additional approvals or permits? <input type="checkbox"/> yes <input type="checkbox"/> no | |
| Building Project Address: _____ | | | | | | Finished Project Value \$ _____ | |
| Zoning District(s): _____ | Zoning Permit No.: _____ | Corner Lot <input type="checkbox"/> yes <input type="checkbox"/> no | Bldg. Height Ft. _____ | Setbacks: _____ | Front _____ | Rear _____ | Left _____ Right _____ |
| Owner's Name(s) _____ | | Mailing Address _____ | | | | Telephone _____ | |
| | | | | | | Email _____ | |
| Contractor Name & Type _____ | | Licen. / Cert # _____ | Exp. Date _____ | Mailing Address _____ | | Telephone & Email _____ | |
| Construction Contractor _____ | | _____ | _____ | _____ | | Tel. _____ | |
| Dwelling Contractor Qualifier _____ | | _____ | _____ | The Dwelling Contr. Qualifier shall be an owner, CEO, COB or employee of the Dwelling Contr. | | Email _____ | |
| HVAC Contractor _____ | | _____ | _____ | _____ | | Tel. _____ | |
| Electrical Contractor _____ | | _____ | _____ | _____ | | Email _____ | |
| Master Electrician _____ | | _____ | _____ | _____ | | Tel. _____ | |
| Plumbing Contractor _____ | | _____ | _____ | _____ | | Email _____ | |
| RESIDENTIAL Single Family/Duplex | Addition: <input type="checkbox"/> Electrical <input type="checkbox"/> Plumbing <input type="checkbox"/> HVAC <input type="checkbox"/> Construction _____ sq. ft. <input type="checkbox"/> Erosion Control | | | | | | |
| | Detached Accessory Building: <input type="checkbox"/> Electrical <input type="checkbox"/> Plumbing <input type="checkbox"/> HVAC <input type="checkbox"/> Construction _____ sq. ft. | | | | | | |
| | Remodel: <input type="checkbox"/> Electrical <input type="checkbox"/> Plumbing <input type="checkbox"/> HVAC <input type="checkbox"/> Construction _____ sq. ft. | | | | | | |
| | Other: <input type="checkbox"/> Fence <input type="checkbox"/> Electrical <input type="checkbox"/> Plumbing <input type="checkbox"/> HVAC <input type="checkbox"/> Construction _____ sq. ft. <input type="checkbox"/> Erosion Control <input type="checkbox"/> Electrical Service Upgrade (Amp _____) <input type="checkbox"/> Removal of Structure (Raze) <input type="checkbox"/> _____ | | | | | | |
| COMMERCIAL | New Commercial Building: _____ Bldg. Sq. Ft. <input type="checkbox"/> Electrical <input type="checkbox"/> Plumbing <input type="checkbox"/> HVAC <input type="checkbox"/> Construction <input type="checkbox"/> Erosion Control | | | | | | |
| | Commercial Addition/Alteration: <input type="checkbox"/> Electrical <input type="checkbox"/> Plumbing <input type="checkbox"/> HVAC <input type="checkbox"/> Construction <input type="checkbox"/> Erosion Control _____ Building Sq. Ft. <input type="checkbox"/> Electrical Service (Amp _____) <input type="checkbox"/> Fence <input type="checkbox"/> Sign <input type="checkbox"/> Removal of Structure (Raze) | | | | | | |
| | State of Wisconsin Plan Approval Needed: <input type="checkbox"/> yes <input type="checkbox"/> no (Approved plans must be submitted with permit application) | | | | | | |
| Zoning – When applicable, owner shall research setback information regarding height, lot coverage, etc. prior to submittal of this application. | | | | | | | |
| I agree to comply with all applicable codes, statutes and ordinances and with the conditions of this permit; understand that the issuance of the permit creates no legal liability, express or implied, on the state or municipality; and certify that all the above information is accurate. If I am an owner applying for an erosion control or construction permit, I have read the cautionary statement regarding contractor financial responsibility on the reverse side of the last page of this application. I expressly grant the building inspector or the inspector's authorized agent permission to enter the premises for which this permit is sought at all reasonable hours and for any proper purpose to inspect the work which is being done. It is the Owner/Contractors Responsibility to Call in ALL INSPECTIONS to the Inspector. | | | | | | | |
| APPLICANT (Print) _____ | | | | SIGN: _____ | | DATE: _____ | |
| APPROVAL CONDITIONS This permit is issued pursuant to the following conditions. Failure to comply may result in suspension or revocation of this permit or other penalty. <input type="checkbox"/> See attached for conditions of approval. | | | | | | | |
| BELOW SECTION FOR OFFICE USE ONLY | | | | | | | |
| FEES: | | PERMIT(S) ISSUED | | PERMIT ISSUED BY: | | | |
| Construction | \$ _____ | <input type="checkbox"/> Construction | | Name _____ | | | |
| Plumbing | \$ _____ | <input type="checkbox"/> HVAC | | Date _____ Telephone _____ | | | |
| Electrical | \$ _____ | <input type="checkbox"/> Electrical | | Cert No. _____ Census Code _____ | | | |
| HVAC | \$ _____ | <input type="checkbox"/> Plumbing | | www.generalengineering.net | | | |
| Zoning | \$ _____ | <input type="checkbox"/> Erosion Control | | VER. 1/3/2018 | | | |
| Other _____ | \$ _____ | <input type="checkbox"/> Other _____ | | | | | |
| Administrative | \$ _____ | | | | | | |
| Total Permit Fee | \$ _____ | | | | | | |

Cautionary Statement to Owners Obtaining Building Permits

101.65(1r) of the Wisconsin Statutes requires municipalities that enforce the Uniform Dwelling Code to provide an owner who applies for a building permit with a statement advising the owner that:

If the owner hires a contractor to perform work under the building permit and the contractor is not bonded or insured as required under s. 101.654(2)(a), the following consequences might occur:

(a) The owner may be held liable for any bodily injury to or death of others or for any damage to the property of others that arises out of the work performed under the building permit or that is caused by any negligence by the contractor that occurs in connection with the work performed under the building permit.

(b) The owner may not be able to collect from the contractor damages for any loss sustained by the owner because of a violation by the contractor of the one and two family dwelling code or an ordinance enacted under s. 101.654(1)(a), because of any bodily injury to or death of others or damage to the property of others that arises out of the work performed under the building permit or because of any bodily injury to or death of others or damage to the property of others that is caused by any negligence by the contractor that occurs in connection with the work performed under the building permit.

☐ *I vouch that I am or will be owner-occupant of this dwelling for which I am applying for an erosion control or construction permit without a Dwelling Contractor Certification and have read the cautionary statement regarding contractor responsibility above.*

Wetlands Notice to Permit Applicants

You are responsible for complying with State and Federal laws concerning the construction near or on wetlands, lakes and streams. Wetlands that are not associated with open water can be difficult to identify. Failure to comply may result in removal or modification of construction that violates the law or other penalties or costs may incur. For more information, visit the Department of Natural Resources wetlands identification web page or contact a Department of Natural Resources service center.

Additional Responsibilities for Owners of Projects Disturbing One or More Acre of Soil

I understand that this project is subject to Ch. NR 151 regarding additional erosion control and stormwater management and will comply with those standards.

Cautionary Statement to Contractors for Projects Involving Building Built Before 1978

If this project is in a dwelling or child-occupied facility built before 1978 and disturbs 6 sq. ft. or more of paint per room, 20 sq. ft. or more of exterior paint or involves windows, then the requirements of DHS Ch. 163 requiring Lead-Safe Renovation Training and Certification apply. Call (608) 261-6876 or go to the Wisconsin Department of Health Services lead homepage for details of how to be in compliance.

Contractor Credential Requirements

All contractors shall possess an appropriate contractor credential issued by the Wisconsin Division of Industry Services. Contractors are also required to only subcontract with contractors that hold the appropriate contractor credential.

By signing this document, owner confirms that he/she has read and understands all of the above stated information.

Owner's Signature: _____ Date: _____

Owner's Printed Name: _____

Residential Deck Informational Handout

For complete code refer to SPS 321, APPENDIX B, and APPENDIX C

At website dsps@wi.gov

All lumber must be a durable species (such as western red cedar) or pressure preservative treated of grade #2 or better of the following types:

Douglas Fir/Larch, Hemlock/Fir, Spruce/Pine/Fir (SPF), and Southern Pine

Lumber in contact with the ground must be rated as **ground contact**. The lumber must be identified by the grade mark of, or certificate of inspection issued by, a professional lumber grading or inspection bureau or agency.

Not all treated lumber is rated for ground contact

See Table C-1 in Appendix C for further information.


Wood/plastic composites: These materials must be labeled indicating their performance criteria and compliance with **ASTMD7032**.

Live Load: All decks shall be designed to support a live load of 40 pounds per square foot. **SPS 321.02**

Fasteners: All fasteners must be galvanized steel, stainless steel, or approved for use with preservative treated lumber. Nails must be threaded, which includes ring shanked annular grooved, and spiral grooved. (An 1/8 inch pilot hole is recommended for all toe nailing locations). Carriage bolts may be substituted where through bolts are specified if carriage bolt washers are installed at the bolt head. (Carriage bolt washers have square holes)

Special Design Note: Some deck designs may not be appropriate for placement of a future screen porch or 3 season room

Frost Footings: Required for any deck or porch that is attached or unattached serving as an exit from a dwelling regardless of building footing. Any Landings or stoops are also required to have frost footings. The minimum depth to the base of the footing is 48". **SPS 321.16**

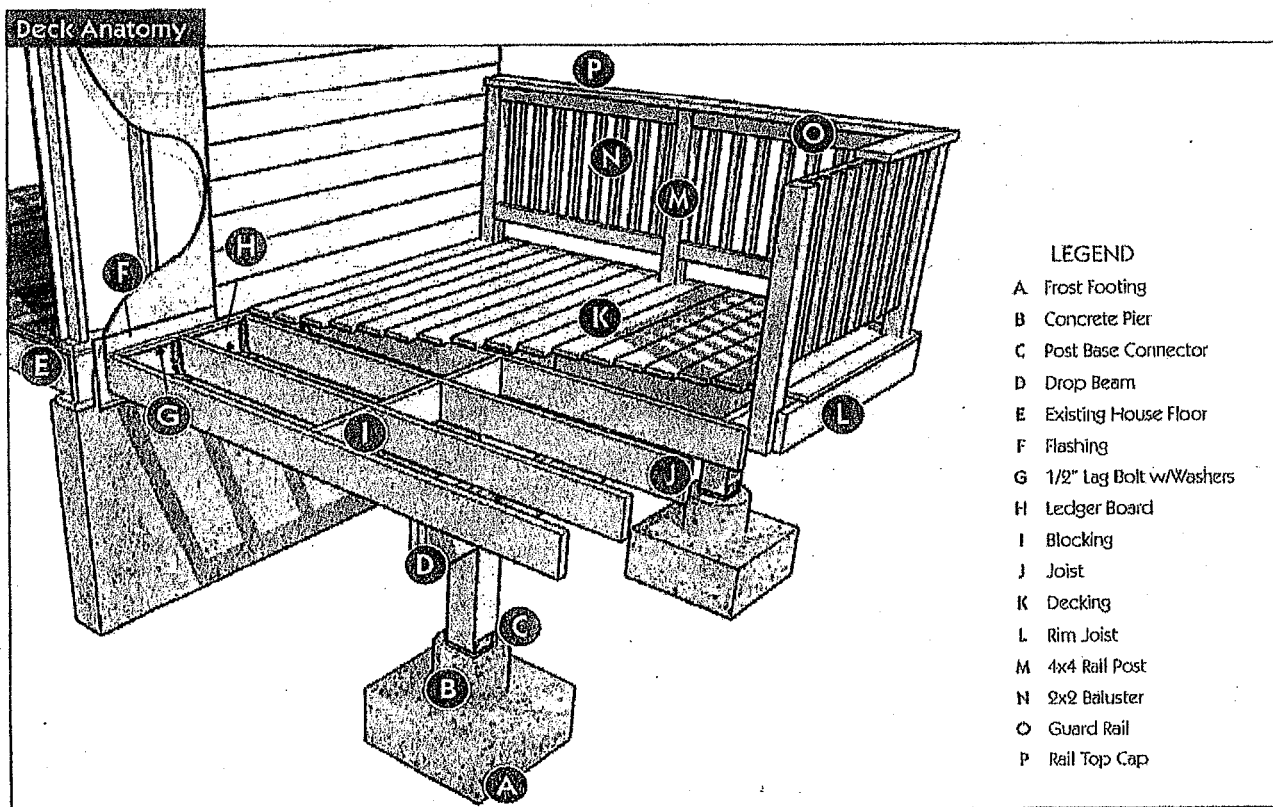

FOOTING SIZE (In Inches)^{1,2,3}


| Joist Length | | Post Spacing (Measured Center to Center) | | | | | | | | | | |
|--------------|----------------------|--|----|----|----|----|----|-----|-----|-----|-----|-----|
| | | 4' | 5' | 6' | 7' | 8' | 9' | 10' | 11' | 12' | 13' | 14' |
| 6' | Corner Footing | 8 | 9 | 10 | 11 | 11 | 12 | 12 | 13 | 14 | 14 | 15 |
| | Intermediate Footing | 10 | 11 | 12 | 13 | 14 | 15 | 15 | 16 | 17 | 17 | 18 |
| | Footing Thickness | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 8 |
| 7' | Corner Footing | 9 | 10 | 13 | 11 | 12 | 13 | 13 | 14 | 15 | 15 | 16 |
| | Intermediate Footing | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 17 | 18 | 19 | 19 |
| | Footing Thickness | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 8 | 8 | 8 |
| 8' | Corner Footing | 10 | 10 | 11 | 12 | 13 | 14 | 14 | 15 | 15 | 16 | 17 |
| | Intermediate Footing | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 19 | 20 | 21 |
| | Footing Thickness | 6 | 6 | 6 | 6 | 6 | 6 | 8 | 8 | 8 | 8 | 8 |
| 9' | Corner Footing | 10 | 11 | 12 | 13 | 14 | 14 | 15 | 16 | 16 | 17 | 18 |
| | Intermediate Footing | 12 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 20 | 21 | 22 |
| | Footing Thickness | 6 | 6 | 6 | 6 | 6 | 8 | 8 | 8 | 8 | 8 | 8 |
| 10' | Corner Footing | 10 | 12 | 12 | 13 | 14 | 15 | 16 | 16 | 17 | 18 | 18 |
| | Intermediate Footing | 13 | 14 | 15 | 17 | 18 | 19 | 20 | 21 | 21 | 22 | 23 |
| | Footing Thickness | 6 | 6 | 6 | 6 | 8 | 8 | 8 | 8 | 8 | 8 | 10 |
| 11' | Corner Footing | 11 | 12 | 13 | 14 | 15 | 16 | 16 | 17 | 18 | 19 | 19 |
| | Intermediate Footing | 13 | 15 | 16 | 17 | 19 | 20 | 21 | 22 | 22 | 23 | 24 |
| | Footing Thickness | 6 | 6 | 6 | 6 | 8 | 8 | 8 | 8 | 8 | 10 | 10 |
| 12' | Corner Footing | 11 | 12 | 14 | 15 | 15 | 16 | 17 | 18 | 19 | 19 | 20 |
| | Intermediate Footing | 14 | 15 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 |
| | Footing Thickness | 6 | 6 | 6 | 8 | 8 | 8 | 8 | 8 | 10 | 10 | 10 |
| 13' | Corner Footing | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 19 | 20 | 21 |
| | Intermediate Footing | 14 | 16 | 17 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 |
| | Footing Thickness | 6 | 6 | 6 | 8 | 8 | 8 | 8 | 10 | 10 | 10 | 10 |
| 14' | Corner Footing | 12 | 13 | 15 | 16 | 17 | 18 | 18 | 19 | 20 | 21 | 22 |
| | Intermediate Footing | 15 | 17 | 18 | 19 | 21 | 22 | 23 | 24 | 25 | 26 | 27 |
| | Footing Thickness | 6 | 6 | 8 | 8 | 8 | 8 | 10 | 10 | 10 | 10 | 10 |
| 15' | Corner Footing | 12 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 22 |
| | Intermediate Footing | 15 | 17 | 19 | 20 | 21 | 23 | 24 | 25 | 26 | 27 | 28 |
| | Footing Thickness | 6 | 6 | 8 | 8 | 8 | 10 | 10 | 10 | 10 | 10 | 12 |
| 16' | Corner Footing | 13 | 14 | 15 | 17 | 18 | 19 | 20 | 20 | 21 | 22 | 23 |
| | Intermediate Footing | 16 | 18 | 19 | 21 | 22 | 23 | 25 | 26 | 27 | 28 | 29 |
| | Footing Thickness | 6 | 8 | 8 | 8 | 8 | 10 | 10 | 10 | 10 | 12 | 12 |

¹ All footing sizes are base diameters².


² For square footings, insert the diameter (d) into the following formula: $\sqrt{((d/2)^2 \times \pi)}$. This number will give you the square dimension and must be rounded up to the nearest inch.

³ Joist length is the joist span plus any overhang beyond the beam.

FOOTINGS

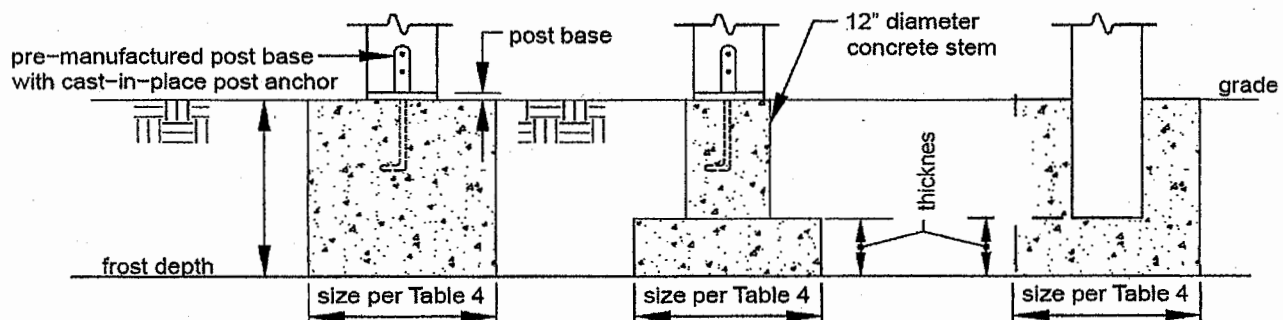

JOIST-TO-BEAM CONNECTIONS

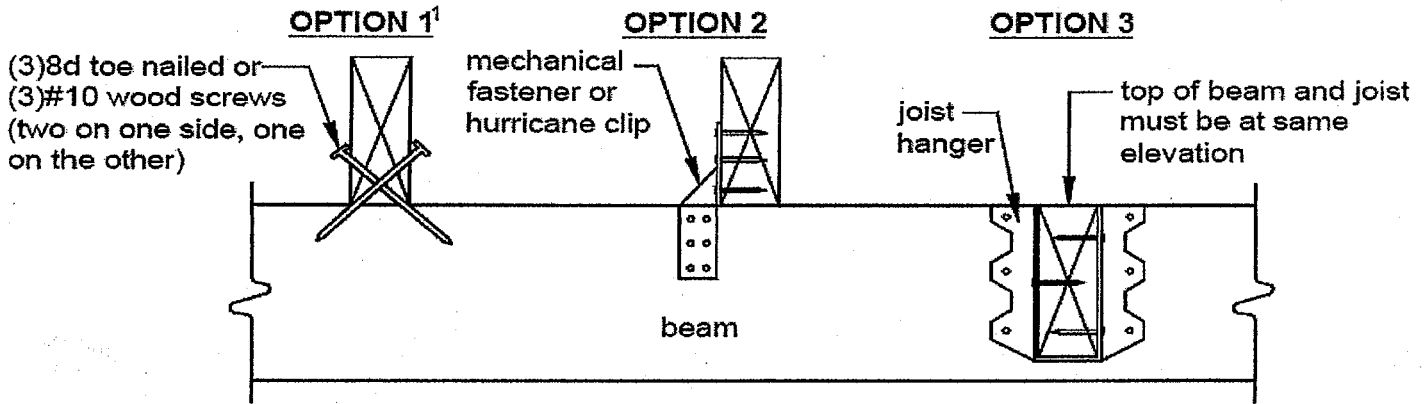

¹Option 1 is not allowed on free-standing decks.

LEDGER ATTACHMENTS

Ledger boards must be attached to the existing house in accordance with all of the following and section 9.


Compliance is critical to ensure the safety and structural stability of your deck.

- 1 The ledger board depth must be greater than or equal to the depth of the deck joists, but not less than a 2"x8". The ledger board must be attached in accordance with one of the conditions shown in following 3 figures, except if metal plate connected wood floor trusses were used in the house.
- 2 The existing band board on the house must be capable of supporting the deck. If this cannot be verified or if existing conditions differ from the details here, then a free standing deck or an engineered design is required.
- 3 The top of the ledger board and the top of the deck joists must be at the same elevation.

Flashing: All connections between deck and dwelling shall be weatherproof. Any cuts in exterior finish shall be flashed. Exterior finish, such as siding, must be removed in the area of the ledger board prior to installation of ledger board. SPS 321.24(3)

Flashing Material: Must be corrosion resistant with a minimum thickness of 0.019.

ATTACHMENT OF LEDGER BOARD TO BAND BOARD OR BAND JOIST

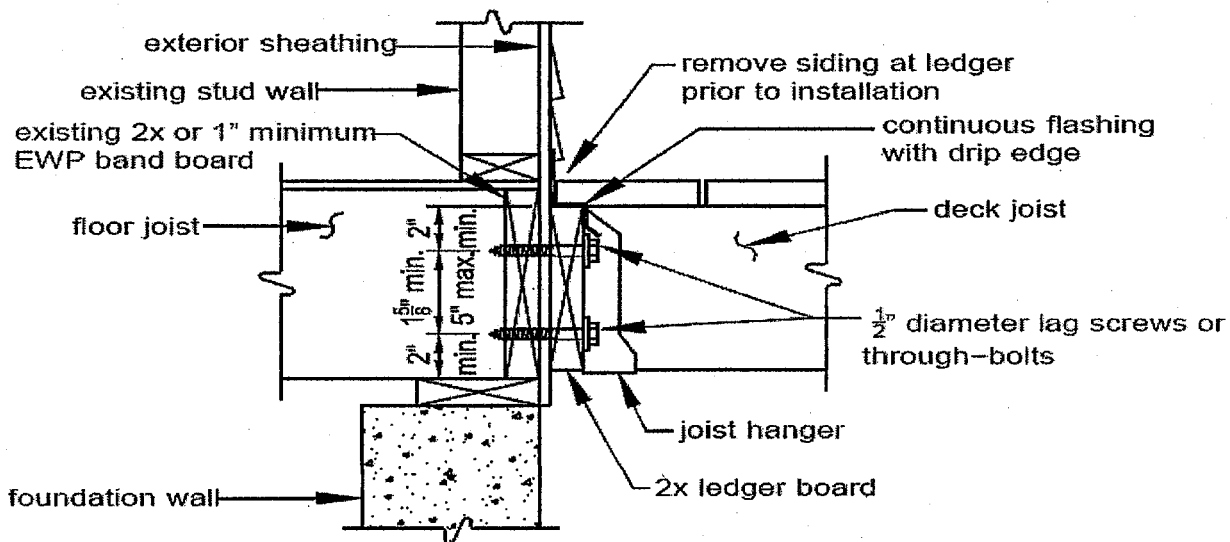

Wood I joists: If the minimum 1" EWP or 2x band board is not present, a free standing deck is required.

Prohibited Ledger Attachments: Through an exterior veneer such as brick, stone, or to or through a masonry chimney

SECTION 3: POSTS AND POST-TO-BEAM CONNECTIONS

Posts must comply with all of the following:

1. The post height, measured from the top of the footing to the underside of the beam, must be in accordance with Table 2.


Table 2
MAXIMUM POST HEIGHT

| Post Size | Maximum Height |
|-----------|----------------|
| 4"x4" | 6' |
| 4"x6" | 8' |
| 6"x6" | 14' |

2. Any post supporting a beam splice must be a minimum of 6"x6".
3. Beams must be attached to posts by the appropriate methods shown in Figure 2. Toe-nailing of beams to posts is prohibited.
4. Post caps, as shown in Figure 2, must be specifically designed for 2- or 3-ply beams and the post size used. Attachment must be in accordance with the manufacturer's instructions.
5. It is recommended that cut-ends of posts should be field-treated with a wood preservative. These preservatives can be found in the paint department of most hardware or home-center stores.

Figure 2

POST-TO-BEAM CONNECTIONS

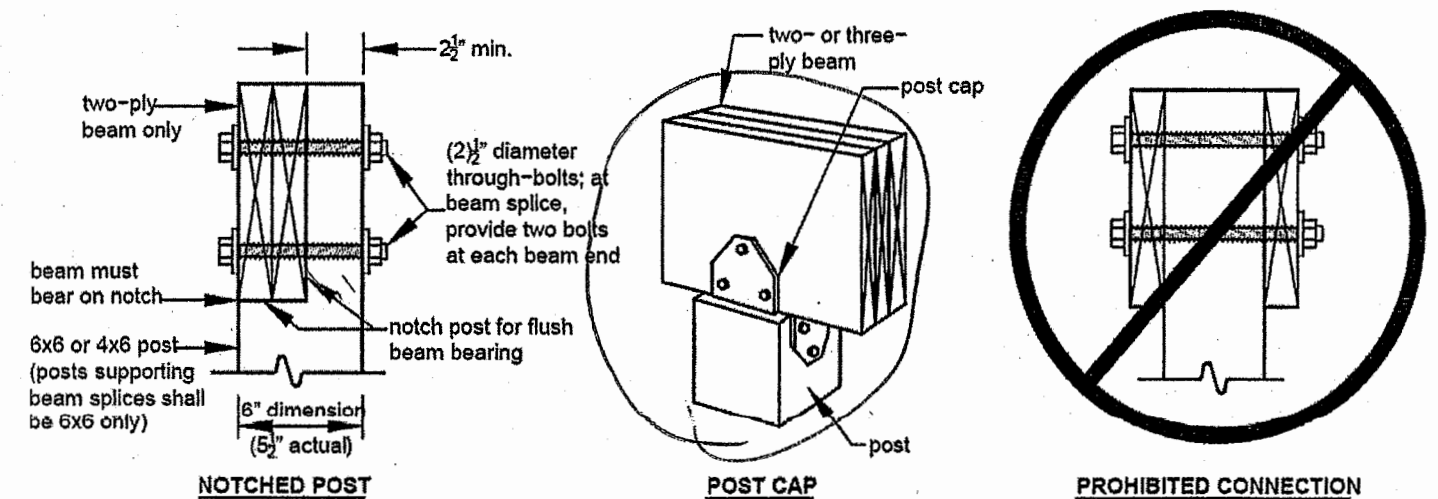

MAXIMUM BEAM SPAN LENGTH¹ FOR DOUGLAS FIR/LARCH³, HEM/FIR³, SPRUCE/PINE/FIR (SPF)³, WESTERN CEDAR, PONDEROSA PINE⁴, AND RED PINE⁴

| Joist Span | (Number of Plies) | | | | | | Beam size - Inches | | | | | |
|------------|-------------------|---------------|-----------------|-----------------|--------|--------|--------------------|--------|--------|--------|---------|---------|
| | 3x6 (2)2x6 | 3x8 (2)2x8 | 3x10 (2)2x10 | 3x12 (2)2x12 | 4x6 | 4x8 | 4x10 | 4x12 | (3)2x6 | (3)2x8 | (3)2x10 | (3)2x12 |
| ≤ 6' | 5'-5" | 6'-10" | 8'-4" | 9'-8" | 6'-5" | 8'-5" | 9'-11" | 11'-5" | 7'-4" | 9'-8" | 12'-0" | 13'-11" |
| ≤ 8' | 4'-8" | 5'-11" | 7'-3" | 8'-5" | 5'-6" | 7'-3" | 8'-7" | 9'-11" | 6'-8" | 8'-6" | 10'-5" | 12'-1" |
| ≤ 10' | 4'-2" | 5'-4" | 6'-6" | 7'-6" | 4'-11" | 6'-6" | 7'-8" | 8'-10" | 6'-0" | 7'-7" | 9'-4" | 10'-9" |
| ≤ 12' | 3'-10" | 4'-10" | 5'-11" | 6'-10" | 4'-6" | 5'-11" | 7'-0" | 8'-1" | 5'-6" | 6'-11" | 8'-6" | 9'-10" |
| ≤ 14' | 3'-6" | 4'-6" | 5'-6" | 6'-4" | 4'-2" | 5'-6" | 6'-6" | 7'-6" | 5'-1" | 6'-5" | 7'-10" | 9'-1" |
| ≤ 16' | 3'-1" | 4'-1" | 5'-1" | 5'-11" | 3'-11" | 5'-2" | 6'-1" | 7'-0" | 4'-9" | 6'-0" | 7'-4" | 8'-6" |
| ≤ 18' | 2'-9" | 3'-8" | 4'-8" | 5'-7" | 3'-8" | 4'-10" | 5'-8" | 6'-7" | 4'-6" | 5'-8" | 6'-11" | 8'-1" |

MAXIMUM BEAM SPAN LENGTH FOR SOUTHERN PINE¹

| Joist Span | (Number of Plies) | | | | Beam Size ² – Inches | | | |
|------------|-------------------|---------|----------|----------|---------------------------------|---------|----------|----------|
| | (2) 2x6 | (2) 2x8 | (2) 2x10 | (2) 2x12 | (3) 2x6 | (3) 2x8 | (3) 2x10 | (3) 2x12 |
| ≤ 6' | 6'-11" | 8'-9" | 10'-4" | 12'-2" | 8'-2" | 10'-10" | 13'-0" | 15'-3" |
| ≤ 8' | 5'-11" | 7'-7" | 9'-0" | 10'-7" | 7'-5" | 9'-6" | 11'-3" | 13'-3" |
| ≤ 10' | 5'-4" | 6'-9" | 8'-0" | 9'-5" | 6'-8" | 8'-6" | 10'-0" | 11'-10" |
| ≤ 12' | 4'-10" | 6'-2" | 7'-4" | 8'-7" | 6'-1" | 7'-9" | 9'-2" | 10'-9" |
| ≤ 14' | 4'-6" | 5'-9" | 6'-9" | 8'-0" | 5'-8" | 7'-2" | 8'-6" | 10'-0" |
| ≤ 16' | 4'-3" | 5'-4" | 6'-4" | 7'-6" | 5'-3" | 6'-8" | 7'-11" | 9'-4" |
| ≤ 18' | 4'-0" | 5'-0" | 6'-0" | 7'-0" | 5'-0" | 6'-4" | 7'-6" | 8'-10" |

MAXIMUM JOIST-SPAN LENGTH¹

| Joist Spacing (on center) | Joist Size | Douglas Fir/Larch, Hem/Fir, SPF ² | | Southern Pine | |
|------------------------------|------------|---|-------------------|---------------------|-------------------|
| | | Without Overhang | With Overhangs | Without Overhang | With Overhangs |
| 12" | 2"x6" | 9'-1" | 8'-1" | 9'-6" | 8'-7" |
| | 2"x8" | 12'-6" | 9'-5" | 13'-1" | 10'-1" |
| | 2"x10" | 15'-8" | 13'-7" | 16'-2" | 14'-6" |
| | 2"x12" | 18'-0" | 18'-0" | 18'-0" | 18'-0" |
| 16" | 2"x6" | 8'-3" | 8'-0" | 8'-7" | 8'-7" |
| | 2"x8" | 11'-1" | 9'-5" | 11'-10" | 10'-1" |
| | 2"x10" | 13'-7" | 13'-7" | 14'-0" | 14'-0" |
| | 2"x12" | 15'-9" | 15'-9" | 16'-6" | 16'-6" |
| 24" | 2"x6" | 6'-9" | 6'-9" | 7'-6" | 7'-6" |
| | 2"x8" | 9'-1" | 9'-1" | 9'-8" | 9'-8" |
| | 2"x10" | 11'-1" | 11'-1" | 11'-5" | 11'-5" |
| | 2"x12" | 12'-10" | 12'-10" | 13'-6" | 13'-6" |

¹ Spans are based on 40 psf live load, 10 psf dead load, normal loading duration, wet service conditions, and deflections of $\Delta=L/360$ for main span and $L/180$ for overhang with a 220 lb. point load.

² Beam depth must be equal to or greater than joist depth if joist hangers are used

³ Incising is assumed.

⁴ Design values based on northern species with no incising assumed.

Beam Span Length: Is measured from center of adjacent posts and does not include overhang.

Beam Cantilevers: Maximum length is equal to ¼ of the actual beam span length. (0.25 x beam span)

Joists Span: Is measured between the centerline of bearing at each joist span end and does not include the overhangs.


Joist Length: Is Joist span plus overhang.

Joist Cantilever: May overhang past the center of the beam up to ¼ of the actual joist span.


Bridging or Solid Blocking: Shall be provided for 2x10 and greater at intervals not exceeding 8'. Must be attached with three 10d toe nails at each end. **SPS 321.22(9)**

Framing Details: Header beams longer than 6' and floor joists longer than 8' framed into beams shall be supported by joist hangers or framing anchors. Floor joists may be supported on ledger strips of at least 2" by 2" nominal. **SPS 321.22(7)**

ATTACHMENT OF LEDGER BOARD TO SOLID FOUNDATION

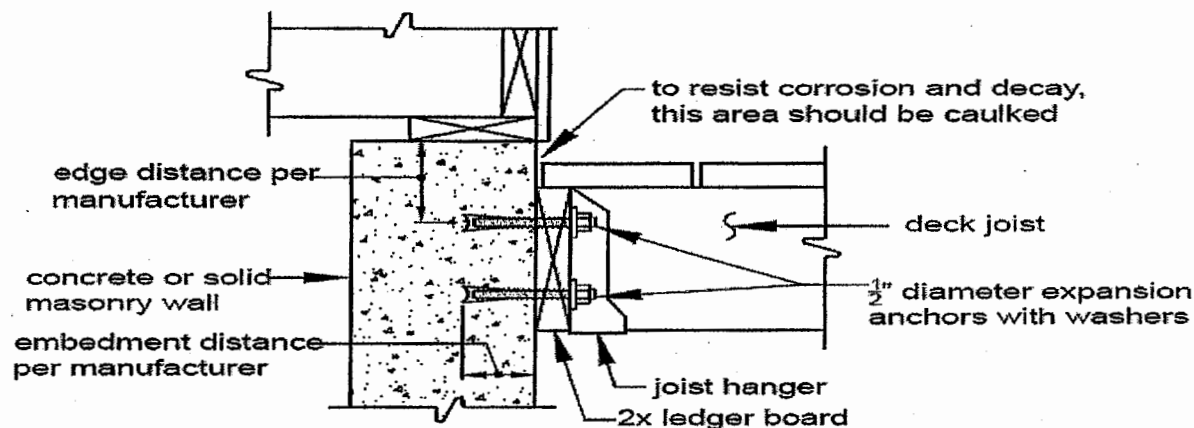

ATTACHMENT OF LEDGER BOARD TO HOLLOW FOUNDATION

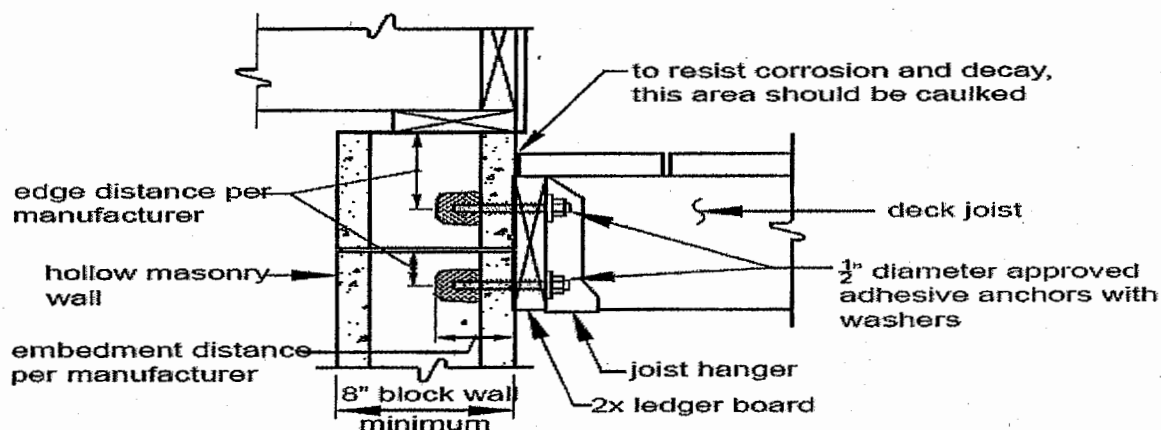

LEDGER BOARD FASTENER SPACING, ON CENTER ^{1,2,3}

| Fastener | Band Board | Joist Span: less than or equal to | | | | | | |
|--|------------|-----------------------------------|-----|-----|-----|-----|-----|-----|
| | | 6' | 8' | 10' | 12' | 14' | 16' | 18' |
| Lag screws | 1" EWP | 24" | 18" | 14" | 12" | 10" | 9" | 8" |
| | 1 1/8" EWP | 28" | 21" | 16" | 14" | 12" | 10" | 9" |
| | 2x Lumber | 30" | 23" | 18" | 15" | 13" | 11" | 10" |
| Through Bolts | 1" EWP | 24" | 18" | 14" | 12" | 10" | 9" | 8" |
| | 1 1/8" EWP | 28" | 21" | 16" | 14" | 12" | 10" | 9" |
| | 2x Lumber | 36" | 36" | 34" | 29" | 24" | 21" | 19" |
| Through Bolts with 1/2" stacked washers ^{4,5} | 2x Lumber | 36" | 36" | 29" | 24" | 21" | 18" | 16" |
| Adhesive anchors | | 32" | 32" | 32" | 24" | 24" | 16" | 16" |

¹ These values are valid for deck ledgers consisting of douglas fir/larch, hem/fir, or southern pine; and for band boards consisting of douglas fir/larch, hem/fir, spruce/pine/fir, southern pine, or engineered wood product (EWP).

² Where solid sawn pressure preservative treated deck ledgers are attached to engineered wood products (minimum 1" thick wood structural panel band joist or structural composite lumber including laminated veneer lumber), the ledger attachment must be designed in accordance with accepted engineering practice. These tabulated values are based on 300 lbs and 350 lbs for 1" and 1 1/8" EWP rim board, respectively.

³ The thickness of the sheathing over the band board must not exceed 15/32".

⁴ The maximum gap between the face of the ledger board and face of the wall sheathing is 1/2".

⁵ Wood structural panel sheathing, gypsum board sheathing, or foam sheathing is permitted between the ledger board and the band board. Stacked washers are permitted in combination with wood structural panel sheathing, but are not permitted in combination with gypsum board or foam sheathing. The maximum distance between the face of the ledger board and the face of the band board is 1".


Diagonal Bracing: Provide diagonal bracing both parallel and perpendicular to the beam at each post as shown in Figure below for decks over 24 inches from grade.

Parallel to the beam: The bracing must be bolted to the post at one end and to the beam at the other.

Perpendicular to the beam: The bracing must be bolted to the post at one end and to a joist or blocking between joists at the other.


For joists that do not align with the bracing location: provide blocking between the adjacent joists.

DIAGONAL BRACING REQUIREMENTS

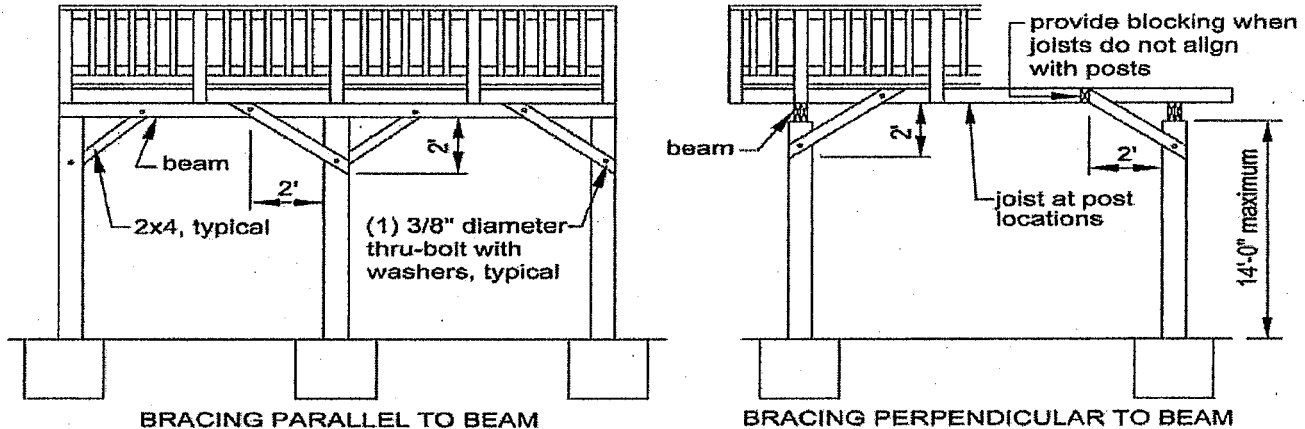


Tension tie requirements: Tension ties can be used in place of perpendicular bracing, but are not allowed on free standing decks. At least 4 ties must be installed, at the end joist and first inside joist at each end of the deck as shown in Figure below. A set of tension-ties must be installed for each structurally independent section of a multi level deck.

TENSION-TIE CONNECTION, WITH LEDGER BOARD

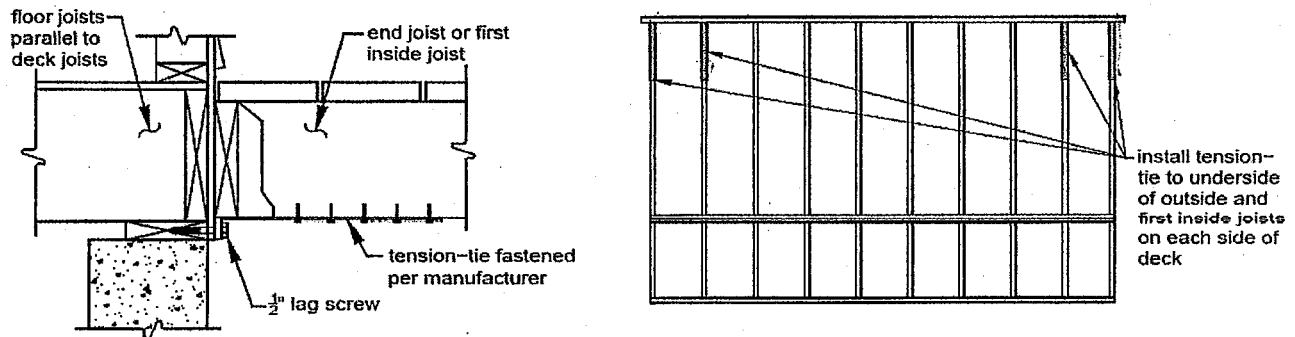


HOLD-DOWN TENSION DEVICE, WITH LEDGER BOARD

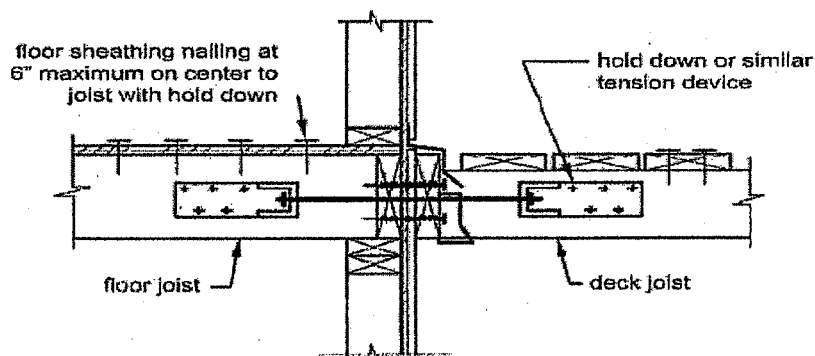

Hold down tension devices: If used instead of perpendicular bracing as described above, must be provided in at least 2 locations per deck. Each device must have an allowable stress design capacity of at least 1,500 pounds.

ATTACHMENT OF FREE-STANDING DECK TO HOUSE FOR LATERAL SUPPORT

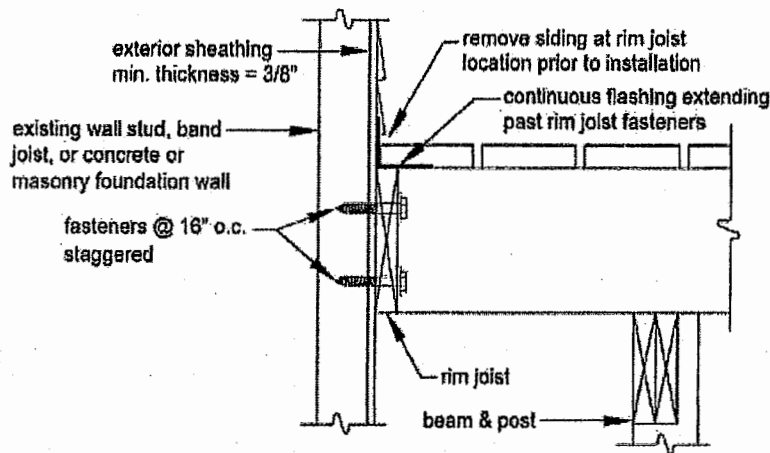


GUARD AND POSTS

All open sides of a deck area that is more than 24 inches above grade at any point within 36 inches beyond the edge of the deck, must have a guard that complies with the figure below, and with all of the following:

- 1 Required horizontal guards shall not have openings from the walking surface to the required guard height which allow passage of a sphere 4 inches in diameter when applying a force of 4 pounds.
- 2 Required guards at stairs shall not have openings which allow passage of a sphere 4 3/8 inches in diameter when applying a force of 4 pounds. The triangle opening formed by the riser, tread, and bottom rail of a guard shall not allow passage of a 6 inch sphere when applying a force of 4 pounds.
- 3 Wet lumber must be spaced such that when shrinkage due to drying occurs the opening is remains compliant.
- 4 Rope, cable, or a similar non rigid material may be used instead of balusters. Must be strung with maximum openings of 3 1/2 inches and with vertical supports no more than 4 feet apart.
- 5 The guard and posts must withstand a 200 pound load applied in any direction.
- 6 Guard infill components, such as balusters and panel fillers, must withstand a horizontally applied perpendicular load of 50 pounds on any one foot square area.
- 7 Wood/plastic composites of equivalent dimensions may be substituted for the guard cap and infill elements shown in the figure below if the manufacturer's instructions permit this use.

GUARDS

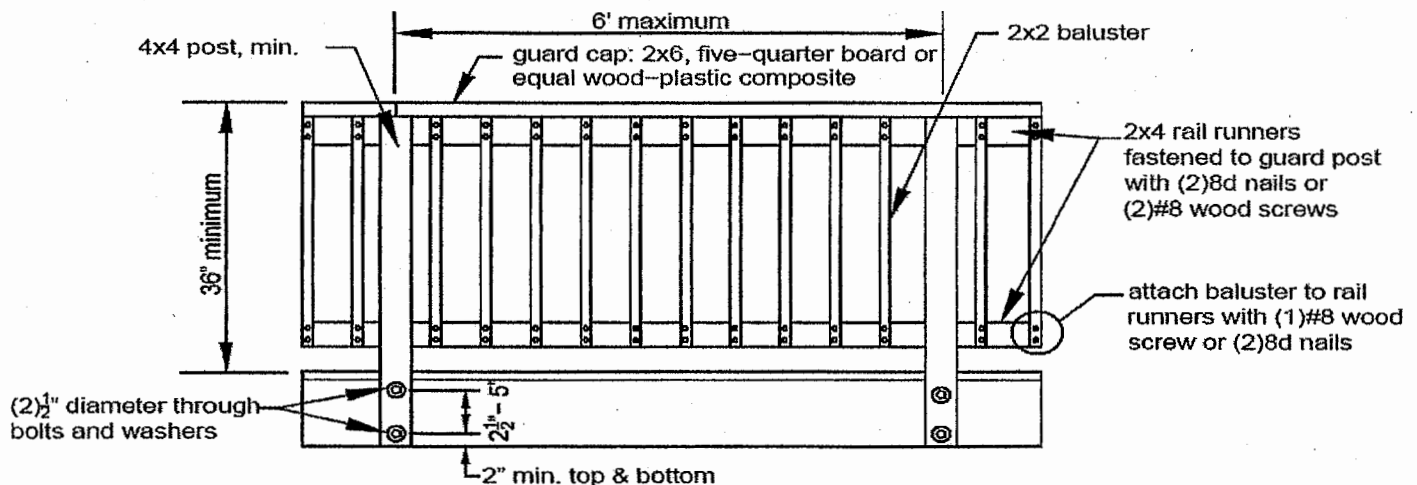


Guard posts. Guard posts must be attached to the deck structure in accordance with all of the following:


Notching guard posts, as shown in Figure 25, is prohibited.

1. Notching guard posts, as shown in Figure 25, is prohibited.
2. Hold-down anchors must have a minimum capacity of 1,800 pounds.
3. Guard posts may be attached to either side of the end joist or rim joist.
4. Bolt holes for a post must be at least 2 inches from the wood edge, at least 2½ inches apart, and no more than 5 inches apart.
5. Hold-down anchors, as shown in Figures 26 and 27, must be used to attach the guard post to the end joist and rim joist, respectively.


Figure 25
POST NOTCHING PROHIBITED

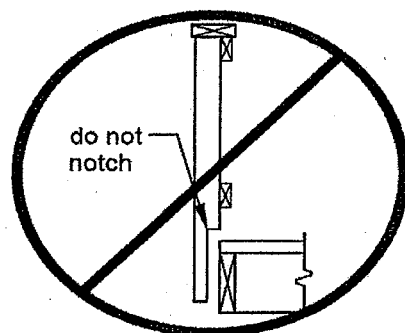

GUARD POST TO END JOIST

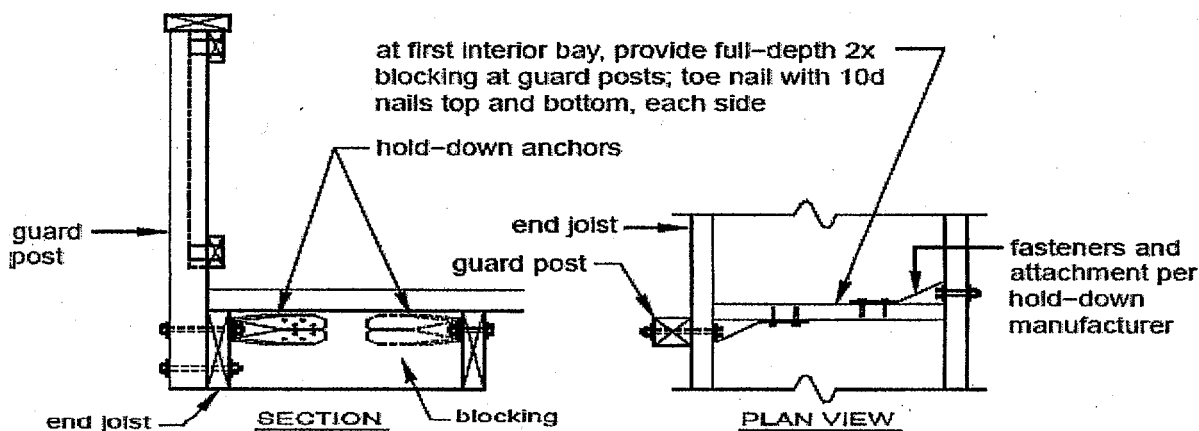

GUARD POST TO RIM JOIST

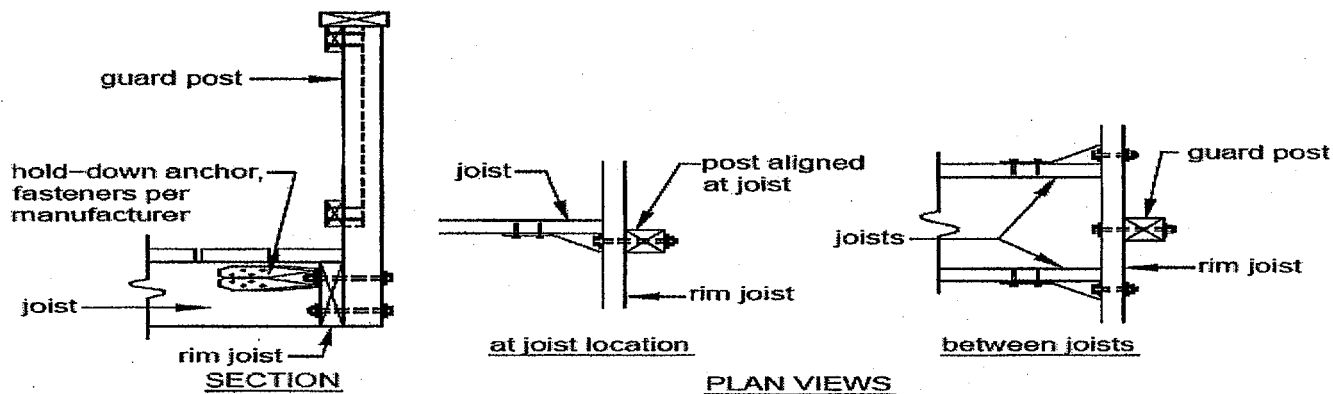


Stairs: Minimum width is 36" SPS 321.04(2)(a). Maximum rise is 8" SPS 321.04(2)(b). Minimum tread depth is 9" SPS 321.04(2)(c). The greatest tread depth may not exceed the smallest tread depth by more than 3/8" throughout run. The greatest riser height may not exceed the smallest riser height by more than 3/8" throughout run SPS 321.04(2)(e). Stairways with open risers shall be constructed to prevent the through passage of a sphere with a diameter of 4 inches or larger between any two adjacent treads SPS 321.04(2)(f).

Ramps: Slope shall not exceed 1 foot of rise in 8 feet of run SPS 321.045.

Stair stringers: Stringers must comply with all of the following:


- 1 Stringers must be sawn or solid 2"x12"s complying with the above tread and riser dimensions.
- 2 Cut stringers must be spaced no more than 18 inches on center.
- 3 Stringers must bear on a solid surface (minimum of 3 1/2 inches thick and 8 inches in diameter) and attach to the deck or a landing in accordance with figure below. Prior to placement of solid surface, all loose or organic material shall be removed.
- 4 Stringer span length is measured using the horizontally projected distance between the centerlines of bearing at each end.
- 5 The span length of a cut stringer must not exceed 6 feet, and the throat size of cut stringers must not be less than 5 inches. Shown in stringer span length figure.

STRINGER BEARING

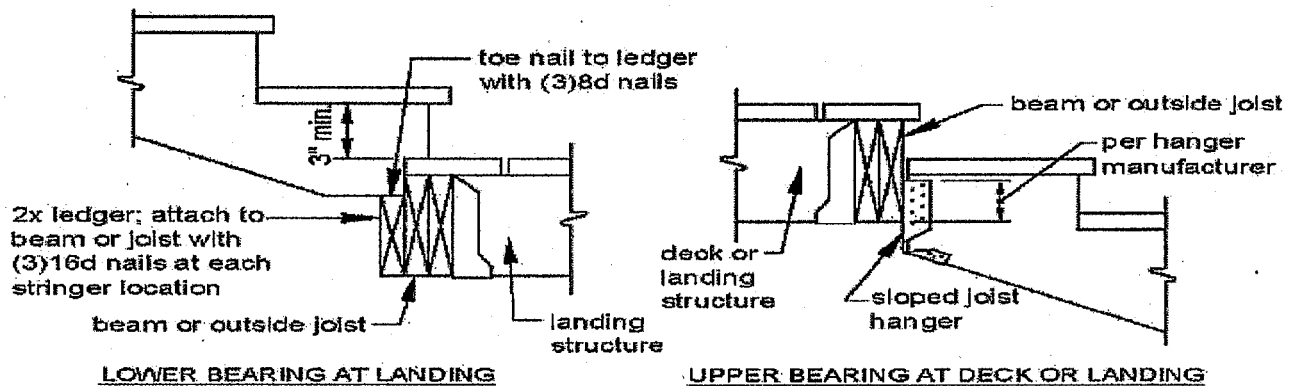


Solid stringer exception: Stringers for a stairway that has a width of 36 inches may have a horizontally projected span of up to 13 feet 3 inches if the stairway is framed solely with 2 solid stringers.

Intermediate supported stringers: If the total stringer length exceeds the above dimensions, a 4"x4" post may be provided to support the stringer and shorten its span length. The 4"x4" post must be notched and bolted to the stringer in accordance with post beam connection figure. The post must bear over the middle 1/3 of a footing that is constructed in accordance with Figure 29 and must be attached as shown in post beam connection figure. An intermediate landing as described above may also be provided to shorten the stringer span.

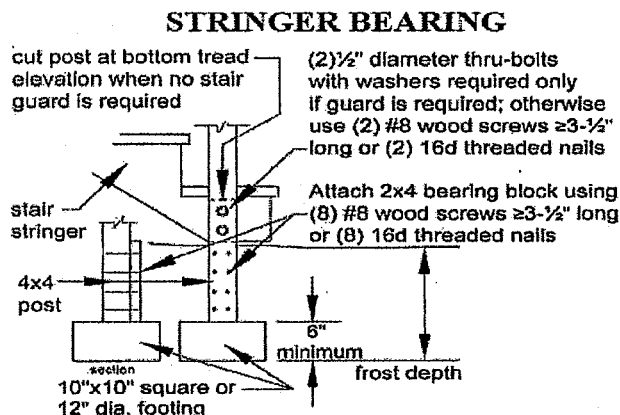


STRINGER SPAN LENGTH

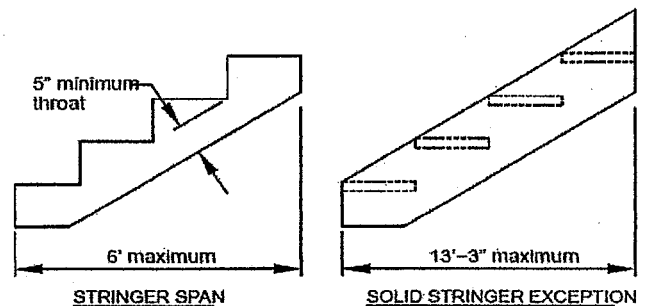

STAIRWAY TREADS

Attachment per tread at each stringer or ledger:

2x_ or 5/4 treads - (2)8d threaded nails or (2)#8 screws $\geq 2\frac{1}{2}$ " long
3x_ treads - (2)16d threaded nails or (2)#8 screws $\geq 3\frac{1}{2}$ " long

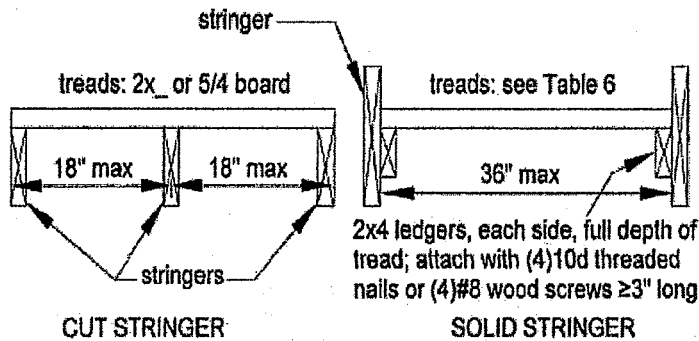

MINIMUM TREAD SIZES¹



| Species | Cut Stringer | Solid Stringer |
|---|--------------|----------------|
| Douglas Fir/ Larch, Hem/ Fir. SPF ² | 2x4 or 5/4 | 2x8 or 3x4 |
| Southern Pine | 2x4 or 5/4 | 2x8 |
| Redwood, West- ern Cedars, Pon- derosa Pine ³ , Red Pine ³ | 2x4 or 5/4 | 2x10 or 3x4 |

¹ Assumes 300 lb concentrated load, L/288 deflection limit, No. 2 grade, and wet service conditions.

² Incising assumed for refractory species including Douglas fir-larch, hem-fir, and spruce-pine-fir.

³ Design values based on northern species with no incising assumed.


STAIR GUARDS

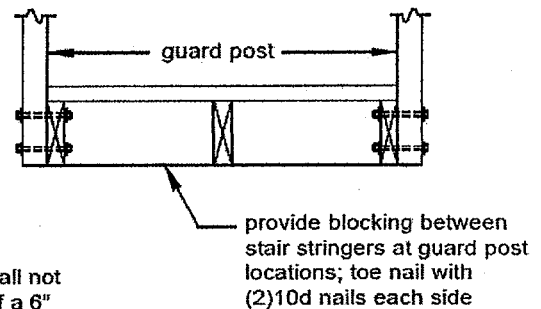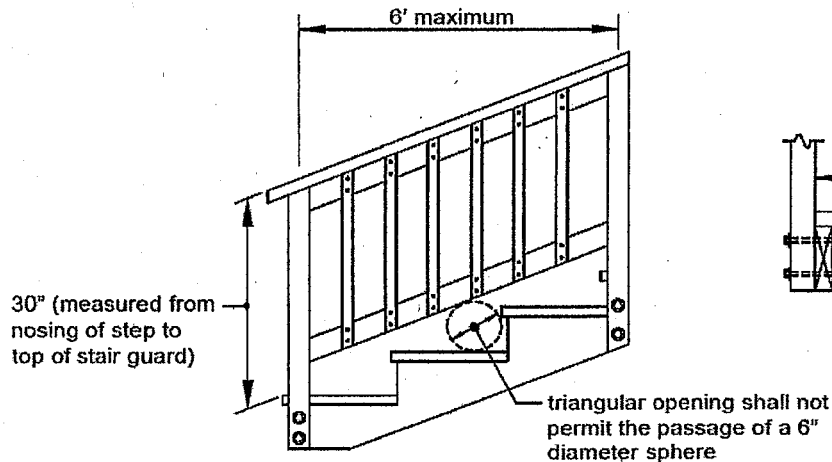

Handrails: Stair of more than 3 risers must have at least one handrail for the full length of the stair. **SPS 321.04(3)**
Top of the handrail shall be at least 30" but not more than 38" above the nosing of the treads. **SPS 321.04(3)(b)**
Handrail size and configuration shall follow code. **SPS 321.04(3)(b)5**



HANDRAIL SHAPES

ROUND

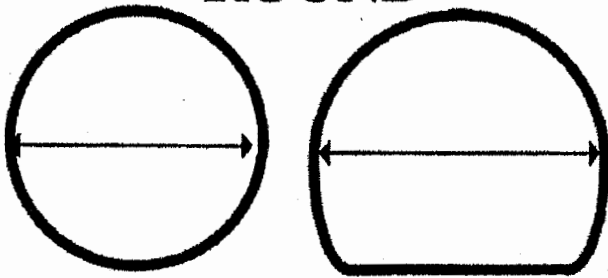

**MAXIMUM 2"
DIAMETER**









RECTANGULAR

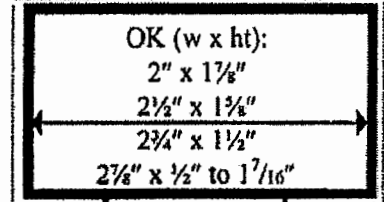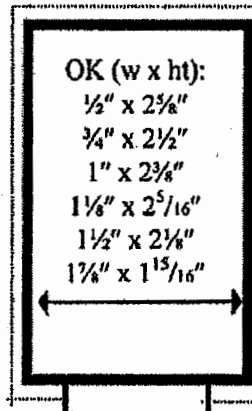

**MAXIMUM 2 $\frac{7}{8}$ "
CROSS SECTION**

**Maximum 6 $\frac{1}{4}$ "
gripping surface
including
minimum $\frac{1}{4}$ " recess
on each side**

OTHERS

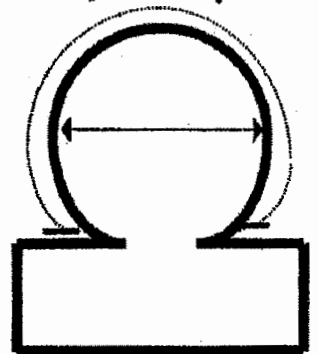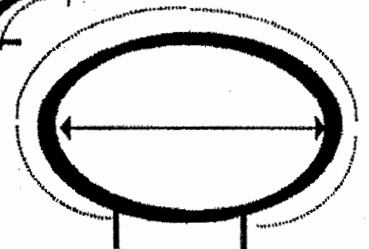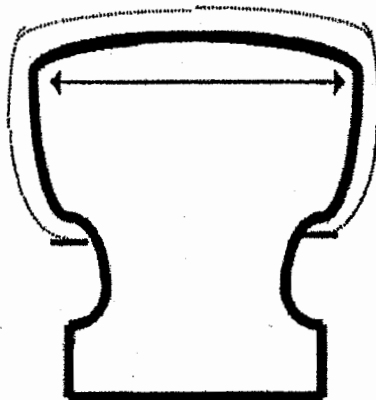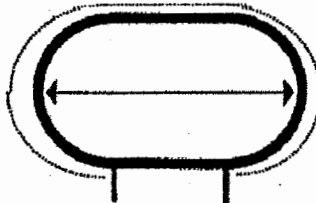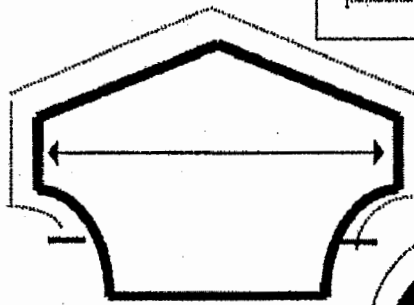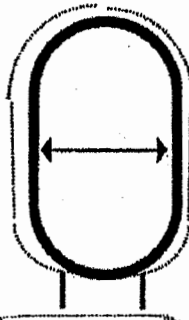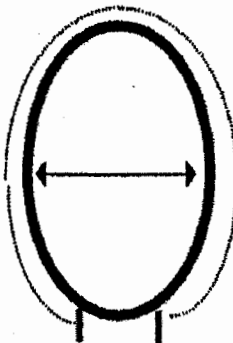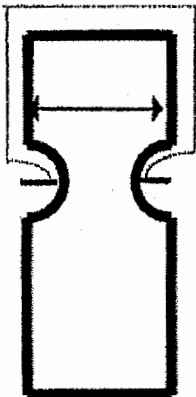

**MAXIMUM 2 $\frac{7}{8}$ "
CROSS SECTION**

**4" to 6 $\frac{1}{4}$ " gripping surface,
including a
minimum $\frac{1}{4}$ " recess on
each side**

INSPECTIONS NEEDED:


Construction Inspection required:

- Footings need to be inspected before backfilling post or placement of concrete
- Prior to decking and after if deck is less than 2 feet from grade.
- After completion if deck is more than 2 feet from grade.

SECTION 15: FRAMING PLAN

A typical framing plan shows a bird's eye or plan view of the joist and beam layout. Location of the ledger board, diagonal bracing or hold down devices, posts, and footings. The type, size, and spacing of the ledger board fasteners. You can use the sample typical deck framing plan shown on the next page in combination with the requirements in this document to complete your deck.

TYPICAL DECK FRAMING PLAN

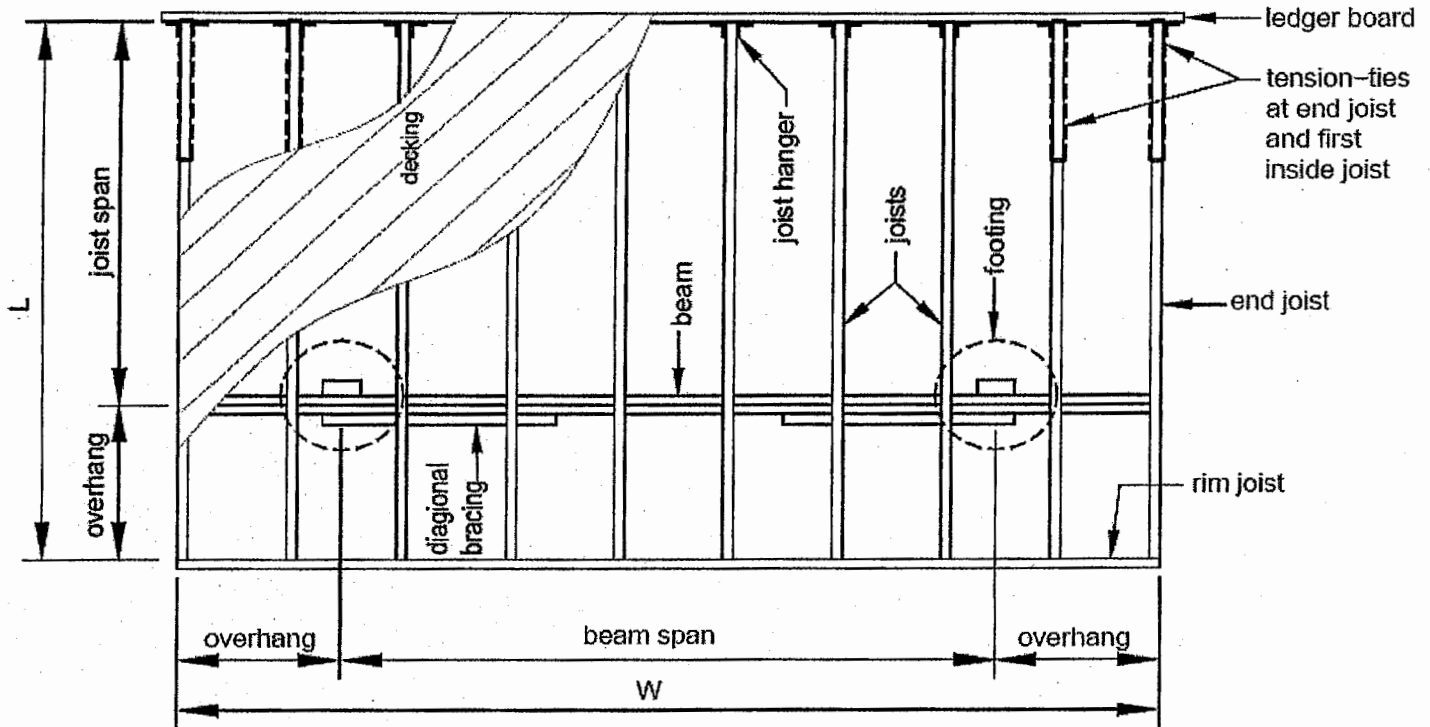

Decking: ☐ 2x4 ☐ 2x6 ☐ five-quarter board ☐ wood-plastic composite (per ASTM D 7032)
☐ Other decking, evaluation report number: _____

Joists: size: ☐ 2x6 ☐ 2x8 ☐ 2x10 ☐ 2x12 spacing: ☐ 12 in. ☐ 16 in. ☐ 24 in.
 joist span dimension: _____ ft. - _____ in.
 overhang: ☐ Yes ☐ No overhang dimension: _____ ft. - _____ in.
 rim joist: ☐ 2x6 ☐ 2x8 ☐ 2x10 ☐ 2x12

Beam(s): number of plies: ☐ 2 ☐ 3 size: ☐ 2x6 ☐ 2x8 ☐ 2x10 ☐ 2x12
 overhang: ☐ Yes ☐ No overhang dimension: _____ ft. - _____ in.

Posts: size: ☐ 4x4 ☐ 4x6 ☐ 6x6 height: _____ ft. - _____ in.

Footings: size: _____ in. ☐ square ☐ round thickness: _____ in.

Ledger: ledger board size: ☐ 2x8 ☐ 2x10 ☐ 2x12 ☐ Not applicable (free-standing deck)
 fastener: ☐ Through bolt ☐ Lag screw ☐ Wood screw
☐ Expansion anchor ☐ Adhesive anchor

Lateral support: ☐ Tension-tie ☐ Diagonal bracing, size: ☐ 2x
 (not permitted for free-standing deck)


Deck size: L=_____ ft. - _____ in. W=_____ ft. - _____ in.

SAMPLE PLOT PLAN

Most work that requires permits also requires a plot plan. A plot plan is a scaled drawing of the construction site. Projects requiring a plot plan include new buildings, additions, major remodeling projects, decks, hot tubs, pools, fences, signs, etc.

This sample plot plan is provided to you to ensure that we receive the required information in order to process your application efficiently. Information required on plot plans includes:

- Location of proposed structure
- Location of all buildings on the property
- Wells
- Disposal systems
- Distance of all of the above from property lines
- Erosion control procedures when required
- Arrows indicating slopes and direction of drainage
- For new dwellings elevations are required per ordinance

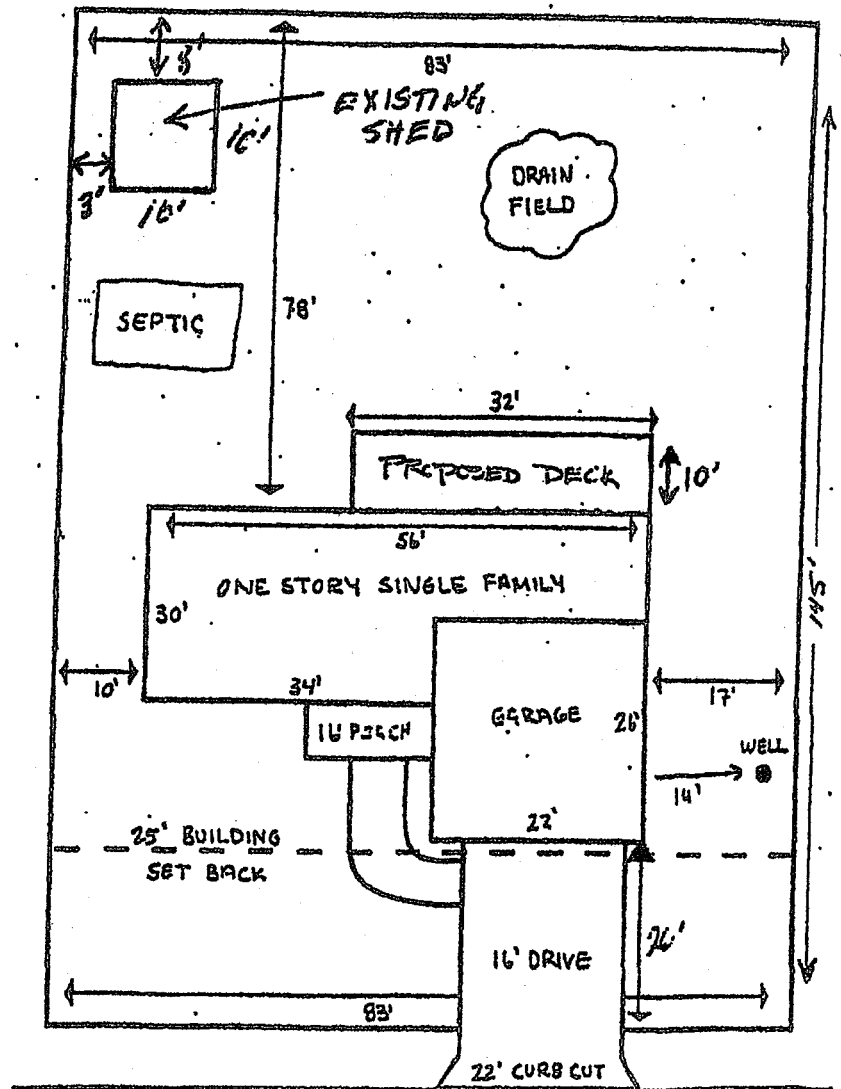

123 E. ELM

SCALE: 1" = 20'